

产品认证证书

II型自愿认证

证书编号: CQC2016010307915101

发证日期: 2022年03月30日

有效期至: 2031年09月23日

委托人名称 ABB S.P.A.
及注册地址 Via Pescaria n°5, 24123 Bergamo Italy

制造商名称 ABB S.P.A.
及注册地址 Via Pescaria n°5, 24123 Bergamo Italy

生产企业名称 ABB S.P.A. - ABB SACE Division
及生产地址 Via Enrico Fermi,14 - 03100 Frosinone Italy

产品名称和系列、规格、型号 塑料外壳式断路器
A2B, A2C, A2N; 型号解释详见附件

产品标准和技术要求 GB/T 14048.2-2020

认证模式 产品型式试验+初次工厂检查+获证后监督

上述产品符合 CQC12-000001-2020 认证规则的要求, 特发此证。

本证书为变更证书, 证书首次颁发日期: 2020年09月02日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

可通过扫描下方二维码或登录国家认监委网站(www.cnca.gov.cn)查验证书信息



授权签字人

陈昕

签发

谢肇煦

中国质量认证中心



<http://www.cqc.com.cn>

中国·北京·南四环西路188号9区 100070

电话: +86 10 83886666

C(2) 0147822

CERTIFICATE OF PRODUCT CERTIFICATION

TYPE II CQC CERTIFICATION

CERTIFICATE NO.: CQC2016010307915101

Valid from: Mar.30,2022

Valid until: Sep.23,2031

NAME AND REGISTERED ADDRESS OF THE APPLICANT ABB S.P.A.
Via Pescaria n°5, 24123 Bergamo Italy

NAME AND REGISTERED ADDRESS OF THE MANUFACTURER ABB S.P.A.
Via Pescaria n°5, 24123 Bergamo Italy

NAME AND LOCATION OF THE FACTORY ABB S.P.A. - ABB SACE Division
Via Enrico Fermi,14 - 03100 Frosinone Italy

PRODUCT NAME, MODEL AND SPECIFICATION Moulded Case Circuit-breaker
A2B , A2C , A2N; See the appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS GB/T 14048.2-2020

TYPE OF CERTIFICATION SCHEMES Type Testing of Product + Initial Factory Inspection + Follow up Factory Inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC12-000001-2020.

Date of original issued: Sep.02,2020

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

The certificate information is available through the QR code below or CNCA's website: www.cnca.gov.cn



SIGN BY

陈昕

SIGNATURE

谢肇煦



CHINA QUALITY CERTIFICATION CENTRE



<http://www.cqc.com.cn>

Section 9, No. 188, Nansihuan Xilu, Beijing 100070 P.R. China

Tel: +86 10 83886666

C(2) 0147822

产品认证证书

II型自愿认证

证书编号: CQC2016010307915101

第1页 共2页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 147822

A2B, A2C, A2N

Ui: 690V;

Uimp: 6kV;

Ue: AC240V, AC415V, AC480V, AC550V, DC250V(两极串);

In: 125A, 150A, 160A, 175A, 200A, 225A, 250A;

Ics 和 Icu 参数如下:

		A2B	A2C	A2N
240Vac	Icu	25kA	50kA	85kA
	Ics	12.5kA	25kA	42.5kA
415Vac	Icu	18kA	25kA	36kA*
	Ics	9kA	12.5kA	18kA
480Vac	Icu	15kA	18kA	25kA
	Ics	7.5kA	9kA	12.5kA
550Vac	Icu	5kA	8kA	10kA
	Ics	2.5kA	4kA	5kA
250Vdc 2 poles in series	Icu	18kA	25kA	36kA
	Ics	9kA	12.5kA	18kA

选择性类别: A;

过电流脱扣器类型: 热磁式;

适用频率: 50/60Hz;

适用隔离;

极数: 3P, 4P

配用辅助触头: 证书编号: CQC2015010304766024

2NO2NC, 3NO3NC

AC-15:Ue/Ie:250V/4A, 125V/5A;

AC-14:Ue/Ie:250V/5A, 125V/6A;

AC-13:Ue/Ie:250V/6A, 125V/6A;

DC-14:Ue/Ie:250V/0.03A, 110V/0.05A;

DC-13:Ue/Ie:250V/0.03A, 110V/0.05A;

DC-12:Ue/Ie:250V/0.3A, 110V/0.5A;



中国质量认证中心



产品认证证书

II型自愿认证


证书编号: CQC2016010307915101

第 2 页 共 2 页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 147822

直流接线图如下:

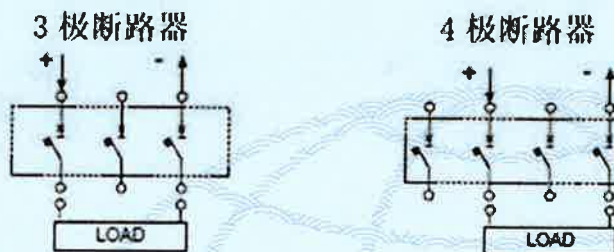

型号解释:

A 2 B/C/N 250
① ② ③ ④

- ①: MCCB Formula Series (Formula 系列塑壳断路器)
- ②: Frame Size 250A (框架电流 250A)
- ③: Breaking Capacity (短路分断能力)
- ④: Rated Current (额定电流)



中国质量认证中心

